

POWER-UNITS No.53A AND No.53B IOV O.25A DC SUPPLY FROM 50Hz AC MAINS

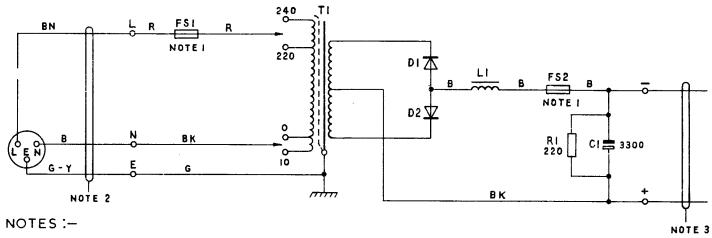

- 1. FSI FUSE No. 36 A /O I FS2 FUSE No. 36/0-5
- 2. CORD FLEXIBLE 3183Y O-75mm² AND BS 3 PIN PLUG TO SUIT SOCKET TO BE REQUISITIONED SEPARATELY AND FITTED LOCALLY FUSED PLUGS TO BE FITTED WITH 3 AMP FUSES
- 3. CABLE DISTRIBUTION 3595 REQUISITIONED SEPARATELY AND FITTED LOCALLY
- 4. THE OUTPUT MUST NOT BE EARTHED

PO TELECOMMS HQRS PAPER:-W DISTN:- GENERAL		NEW FORMAT. TRANSFORMER 200V TAPPING REMOVED	12 · 4 · 77
	E	WIRE COLOURS AND CAPACITOR VALUE CHANGED. NOTES 2&3 AMENDED. NOTE 4 ADDED.53B INTRODUCED D.L.W. TD 7.2.3	
	D	NEW FORMAT KMA	12 - 7 - 66

POWER-UNITS No.53A AND No.53B IOV O.25A DC SUPPLY FROM 50Hz AC MAINS

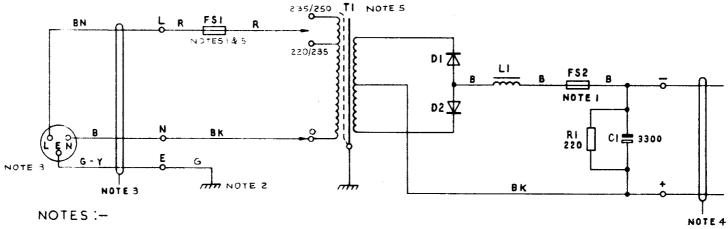

- 1. FSI FUSE No.80A / 0.1 FS2 FUSE No.36/0.5.
- 2. THE MAINS PROTECTIVE EARTH MUST BE CONNECTED TO THE EARTH CONNECTING BLOCK OF THE POWER-UNIT. THE OUTPUT MUST NOT BE EARTHED.
- 3. CORD FLEXIBLE 3183Y 0.75 mm2 AND PLUG No.103 TO BE REQUISITIONED SEPARATELY AND FITTED LOCALLY, PLUGS TO BE FITTED WITH 3 AMP FUSES.
- 4. CABLE DISTRIBUTION 3595 REQUISITIONED SEPARATELY AND FITTED LOCALLY.
- 5. EARLIER VERSIONS OF THE POWER-UNIT MANUFACTURED BEFORE 1983 SHOW DIFFERENT PRIMARY TAPPINGS ON TI. FUSE No. 80A/... (FSI) WAS FUSE No. 36A/...

BRITISH		F	NOTE SADDED, NOTES 1,2 & 3 AMETIC, L. 1.1 (3) NA - 1244 (4)	19-12-83
TELECOMMS HQRS PAPER :- W DISTN :-	155∪E	E	NEW FORMAT, TRANSFORMER 200V TAPPING REMOVED. WIRE COLOURS AND CAPACITOR VALUE CHANGED. NOTES 2&3 AMENDED. NOTE 4 ADDED. 53B INTRODUCED DLW TD 7.2.3	12 4 77
GENERAL		D	NEW FORMAT KMA	12 - 7 - 66