

**TERMINATION OF INTER-P.B.X. EXTN. OR
INTER-P.B.X. PRIVATE CCT. AT SWBDS.
AT 3796 & N1070.**


N777

SIGNALLING GRP.J. (S.C.D.C. DIALLING TO P.A. B.X.'S.)

NOTES:-

1. See Dgm. LD202 for wiring of U.A.A. No.103A.
2. Omit connexions JKB (3) to B.T. term.'S' for Inter-P.B.X. extns. and for Inter-P.B.X. Private ccts. where omission of Exchange Prohibition is authorised.
3. Connect to terminals 1 & 3 where Exchange Prohibition is not required or to terminals 2 & 4 if it is required.
4. Fuse No. 44A/0.5 in a spare fuse position in Switchboard.
5. KD (Key No.253) mounted above Exchange Line Indicators (see Dgm.N880 for details of mounting method).
6. B.T. mounted in Swbd. or spare tags of Exch. Line S.C.
7. For provision of 50V. Power Supply see Works SPEC.S2086.

STRIP CONNEXION
No. 121A IN U.A.A.
No. 103A (NOTE 1)

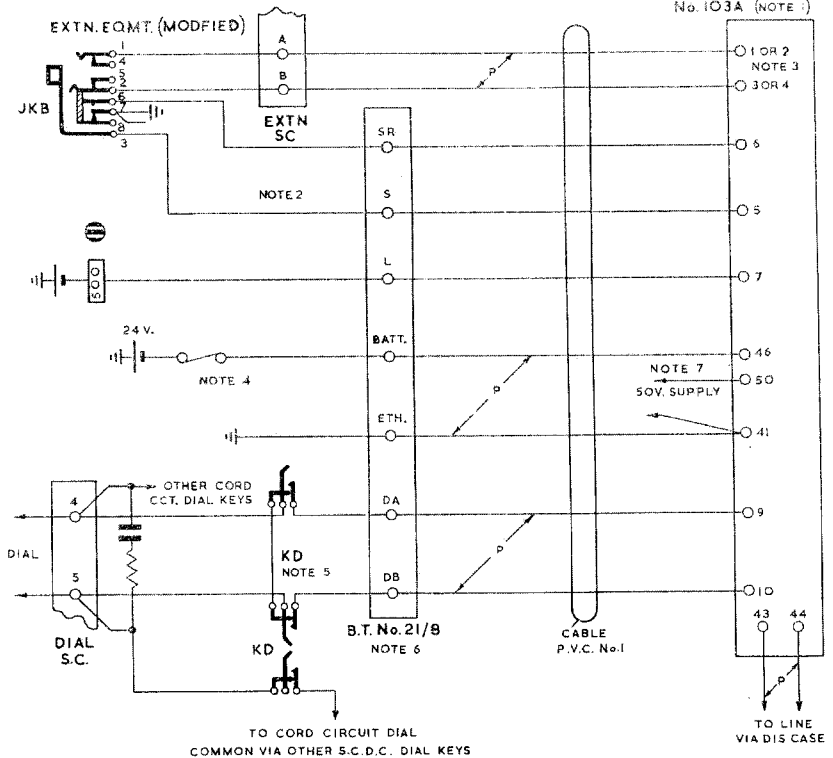

P.O. TELECOMMS HQRS.	ISSUE	<i>R. J. Fisher</i>	TD 1.5.2.
PAPER:-W CIRCULATION: GENERAL			10.7.68.