


HES No.3 (KEYMASTER) CIRCUIT ELEMENTS-POWER FEEDING CIRCUIT

INSTALLATION WITH MULTIPLE STATIONS ONLY

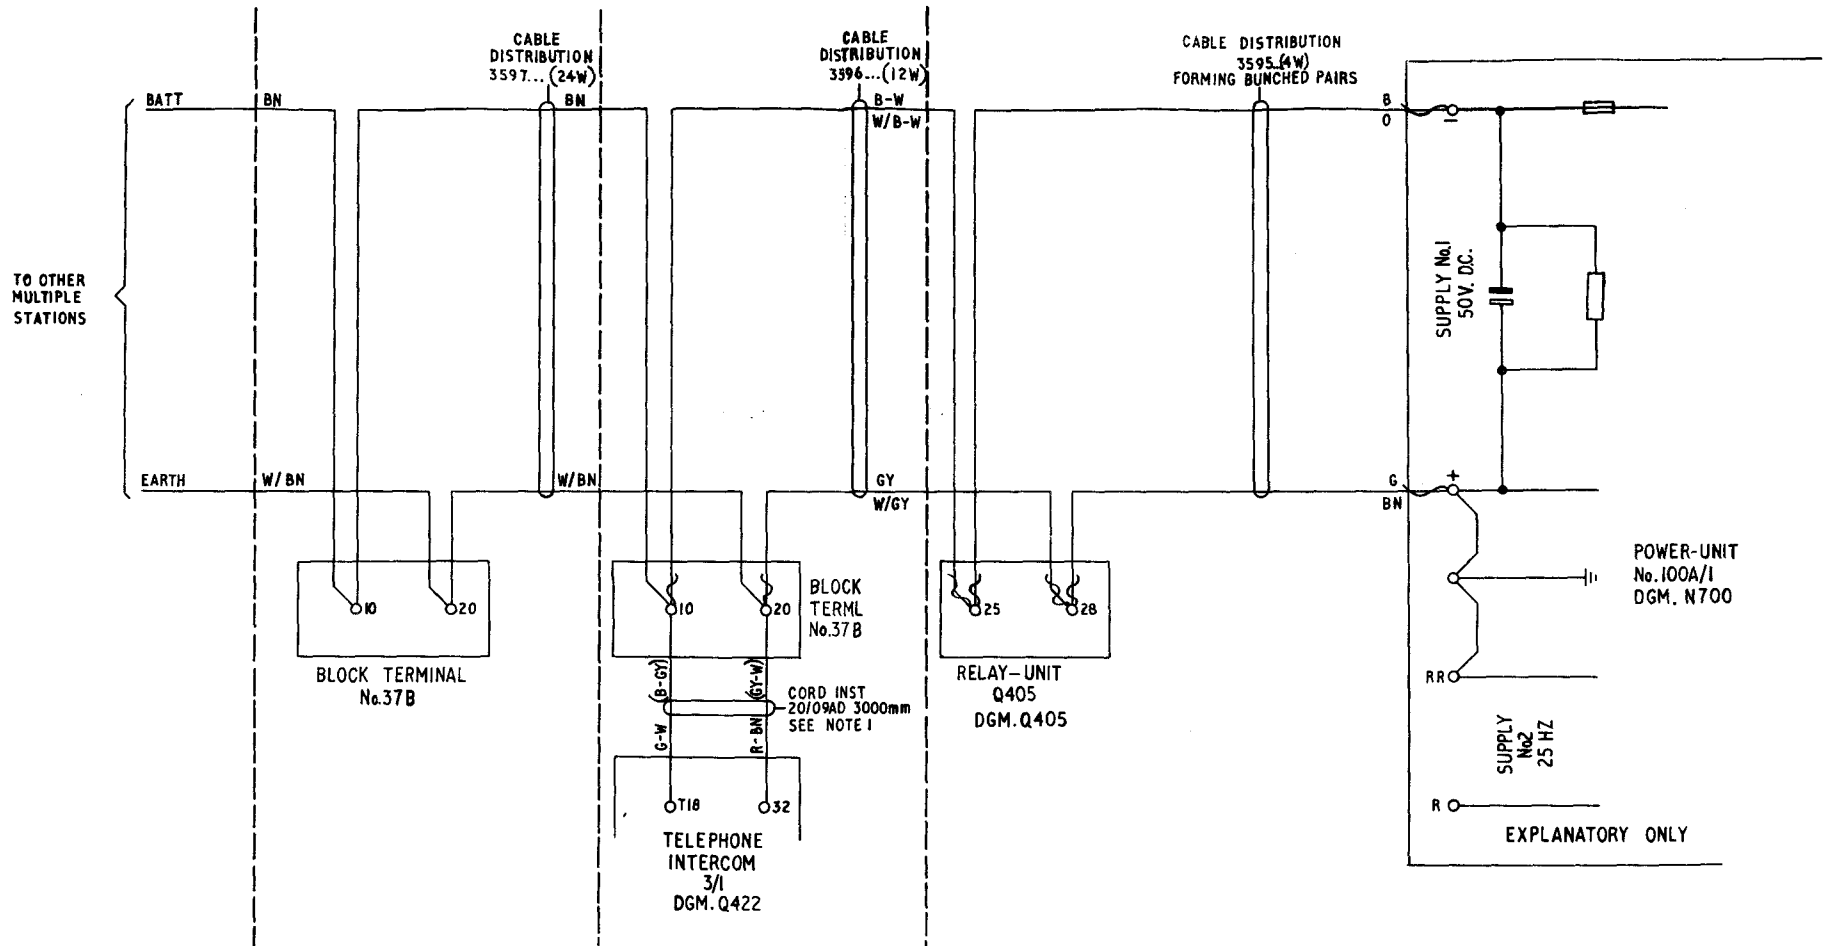

NOTE:-
1. Cord conductor colours shown in brackets refer to Cord Inst. No 20/03AJ

PO TELECOMMS HQRS. PAPER:-W DISTN:- GENERAL	ISSUE		
	B	NEW FORMAT. CORD WAS 20/03AJ. CABLE WAS PVC No.1. POWER UNIT WAS No.51A. <i>MR</i>	18-10-74
	A	MINOR AMENDMENTS.	16-9-63
	J.H. COMBRIDGE TD 7-2-3		15-5-62

POWER AND RINGING FEEDS WHEN RELAY UNITS Q410 AND/OR Q415 ARE FITTED

