

NOTES:-

1. WHERE LESS THAN 10 MULTIPLE STATIONS ARE REQUIRED, THE UNWANTED SECTION OF THE MULTIPLE CABLE ARE OMITTED.
2. CONVERTOR, RINGING No.7, WHICH IS MOUNTED WITHIN POWER UNIT No.52A, IS ONLY REQUIRED WHEN A NON-MULTIPLE EXTENSION, OR AN INTER-SWITCHBOARD CIRCUIT, OR PRIVATE CIRCUIT WITH 'B/AC OUT' SIGNALLING IS PROVIDED.
3. THE CONTROL UNIT Q535, OR Q537, IS LOCATED AT THE MAIN STATION, WHICH MAY BE ANY MULTIPLE STATION.
4. WHERE LESS THAN 4 NON-MULTIPLE EXTENSIONS, OR INTER-SWITCHBOARD CIRCUITS, OR PRIVATE CIRCUITS ARE REQUIRED, OMIT UNWANTED RELAY UNITS Q519, OR Q524.

P.O.E.D. S BCH.	ISSUE	<i>H. J. Powell</i>	5-4-66
PAPER: W CIRCULATION GENERAL			


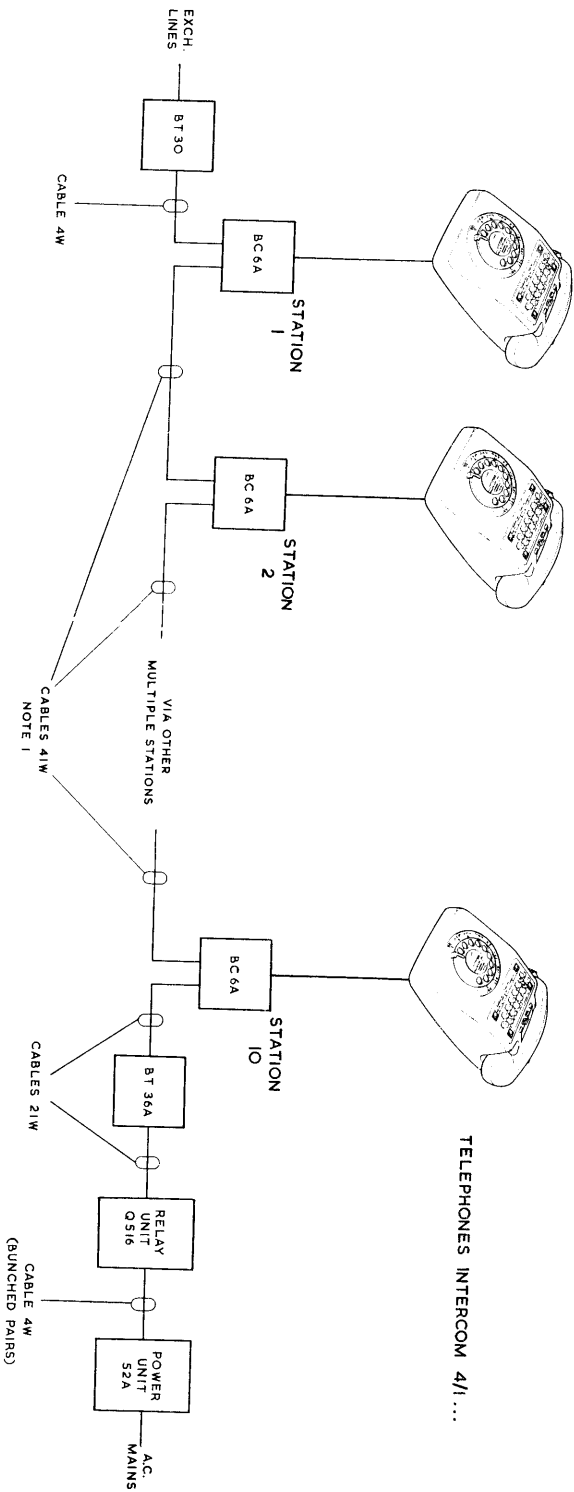


FIG. 1. MULTIPLE STATIONS ONLY


TELEPHONES INTERCOM 4/1...

FIG. 2. MULTIPLE STATIONS AND EITHER A NON-MULTIPLE EXTENSION, OR A PRIVATE CIRCUIT, OR INTER-SWITCHBOARD CIRCUIT.

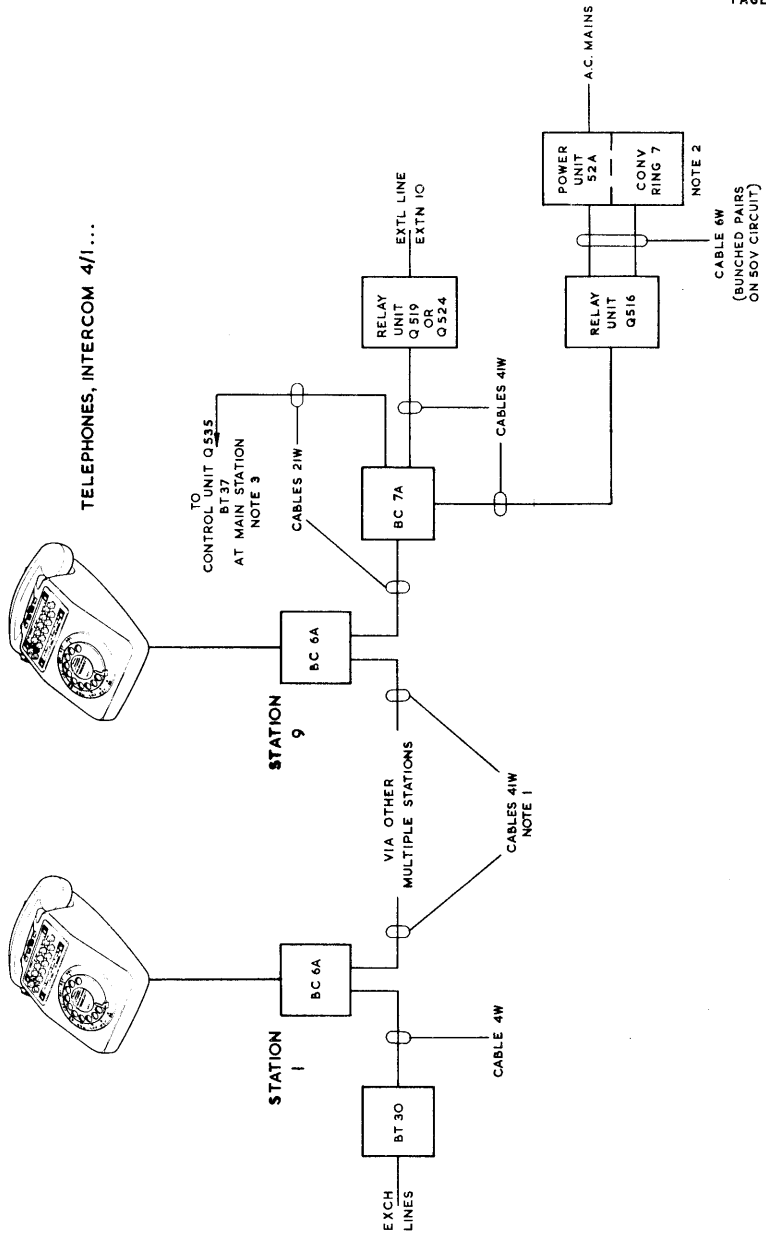

TELEPHONES, INTERCOM 4/1...

FIG. 3. MULTIPLE STATIONS AND FOUR NON-MULTIPLE EXTENSIONS, OR PRIVATE CIRCUITS, OR INTER-SWITCHBOARD CIRCUITS, (NOTE 4).

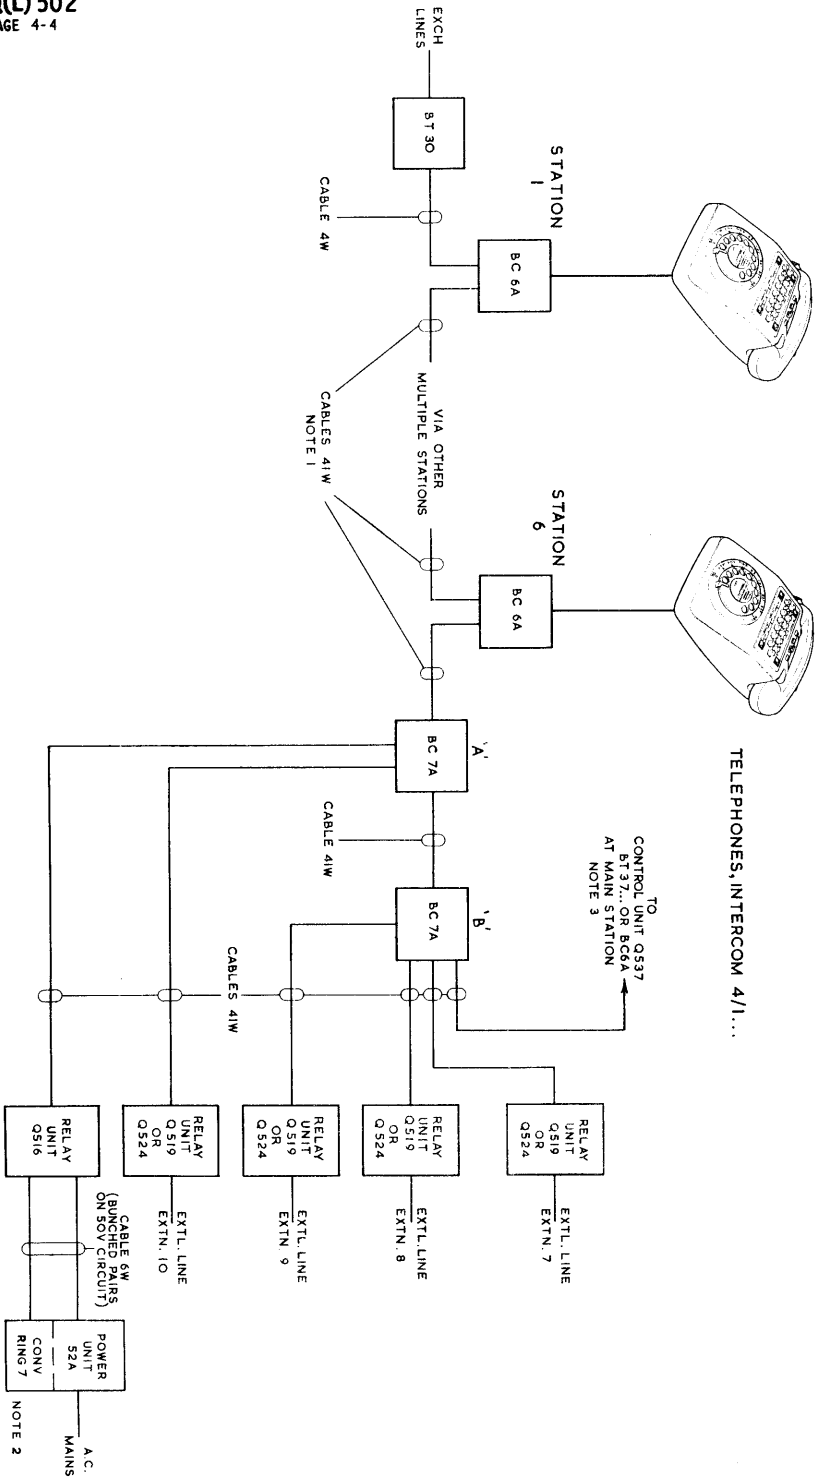

TELEPHONES, INTERCOM 4/1...

TO CONTROL UNIT Q537 AT MAIN STATION NOTE 3

NOTE 2