


INSTALLATION FOR 5 OR MORE 2 LOOP (4 WIRE) CIRCUITS  
(RACK MOUNTING)

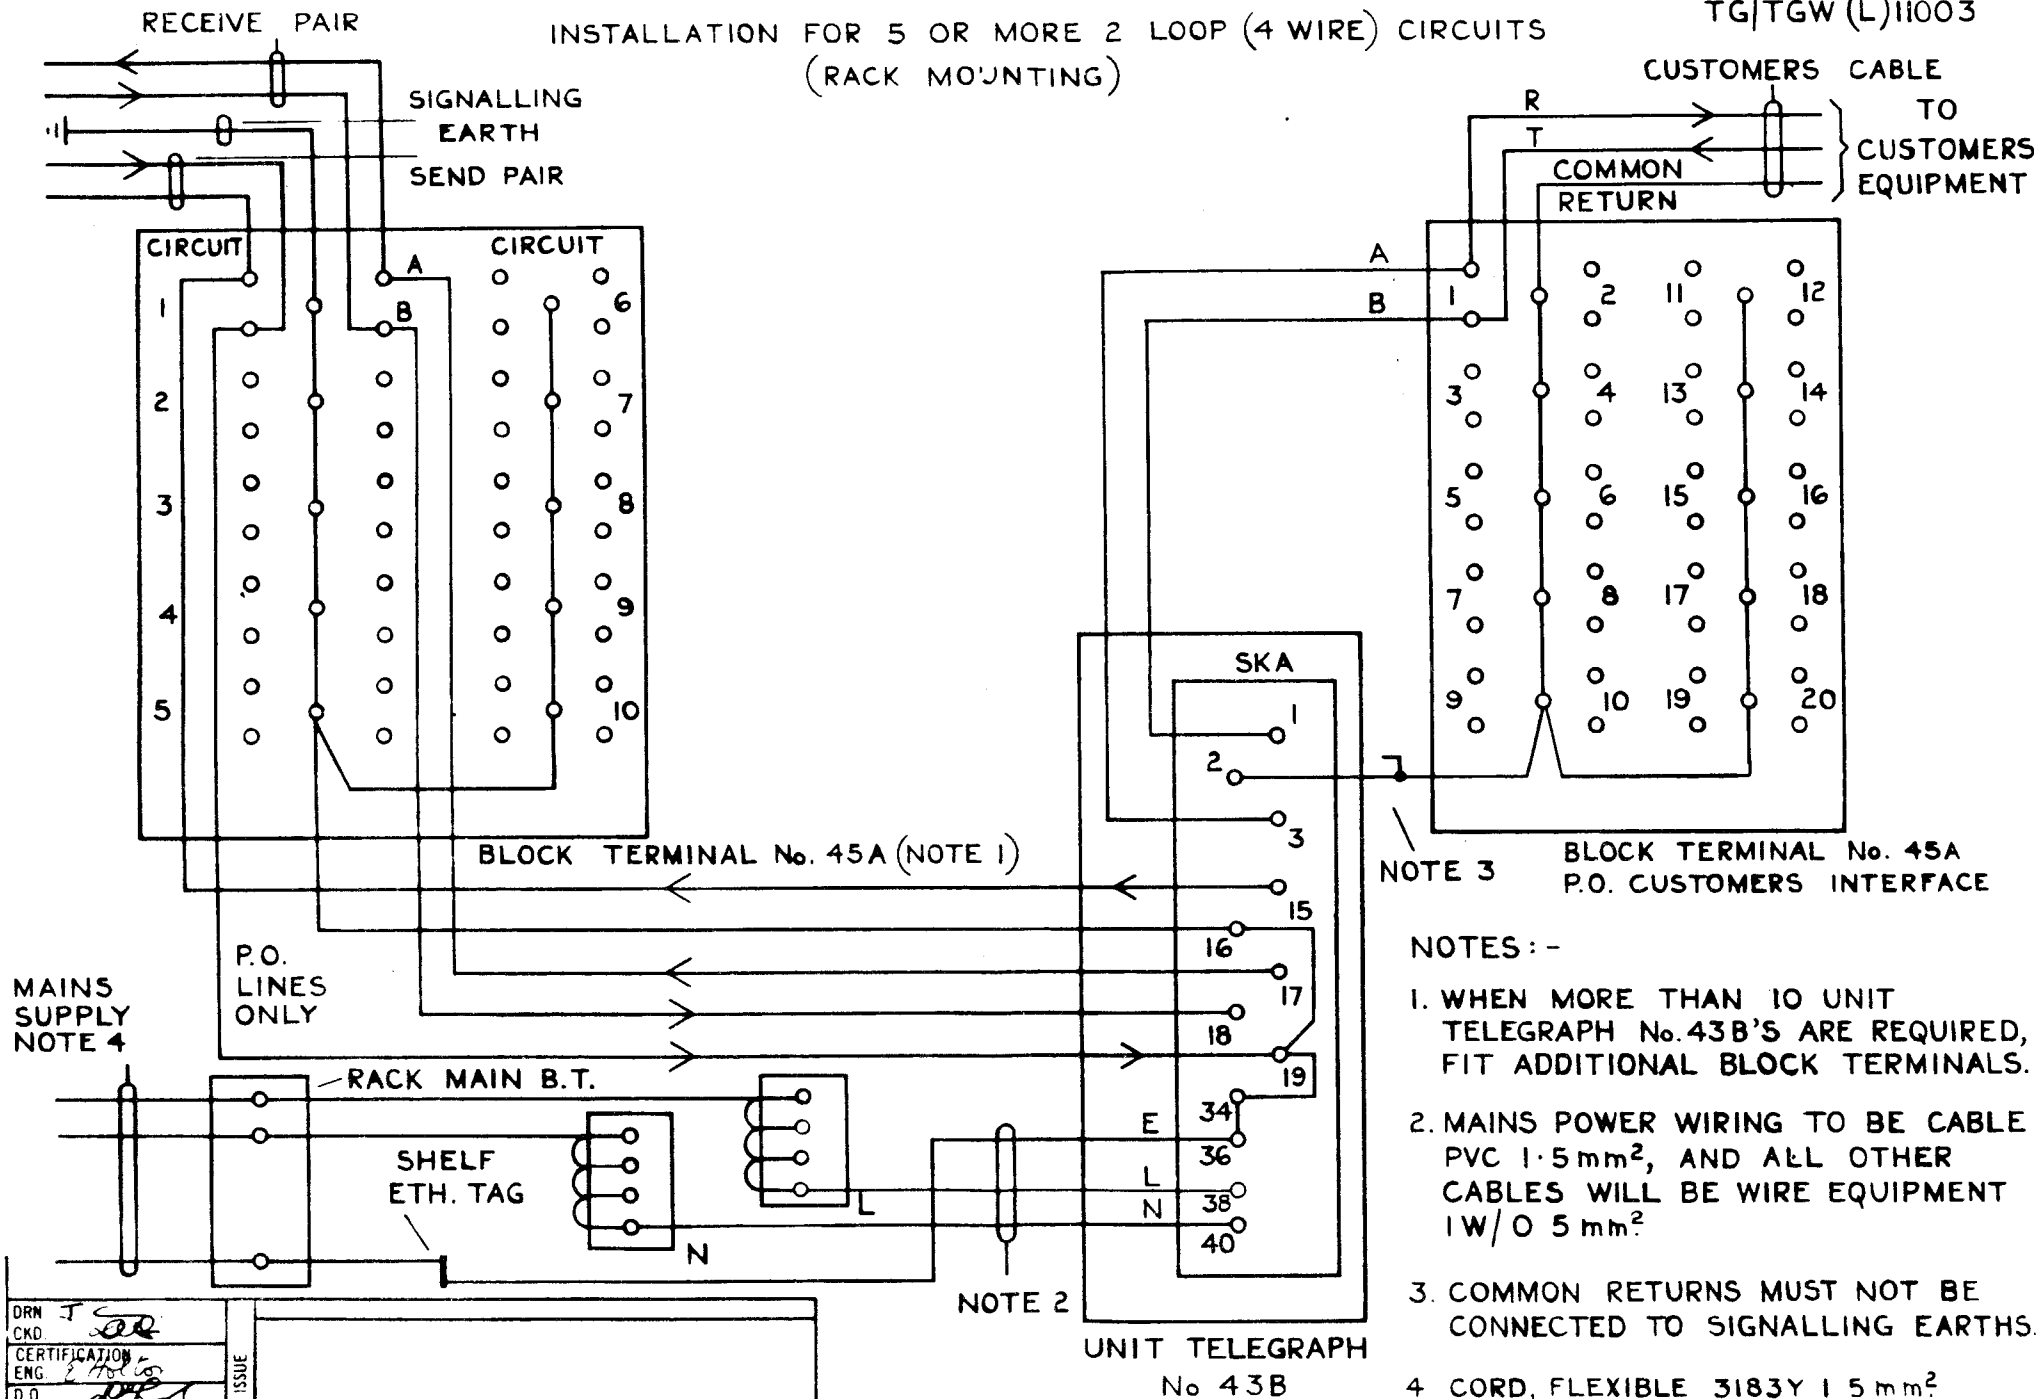

NOTE 3 BLOCK TERMINAL No. 45A  
P.O. CUSTOMERS INTERFACE

NOTES :-

1. WHEN MORE THAN 10 UNIT TELEGRAPH No. 43B'S ARE REQUIRED, FIT ADDITIONAL BLOCK TERMINALS.
2. MAINS POWER WIRING TO BE CABLE PVC 1.5mm<sup>2</sup>, AND ALL OTHER CABLES WILL BE WIRE EQUIPMENT 1W/O 5mm<sup>2</sup>.
3. COMMON RETURNS MUST NOT BE CONNECTED TO SIGNALLING EARTHS.
4. CORD, FLEXIBLE 3183Y 1.5mm<sup>2</sup>

DRM CKD <i>J. S. O.</i>	ISSUE
CERTIFICATION ENG. <i>E. H. S.</i>	
D.O. <i>[Signature]</i>	
DATE 23.11.70	
POST OFFICE TELECOMMUNICATIONS WORKS	
4 P 342	TG/TGW(L)11003