


TELEPRINTER P. W. CIRCUITS.

TG(L)818 G. 22-10-36.

CABLING AT RENTER'S OFFICE FOR DX, HALF DX, OR 2 LOOP SX.CCT.

SUPERSEDED FOR NEW WORK BY TG(L)3525

						G
						5 1-44
						Note 1 and Supersession n/c amended
						Note 3 & S/R Sw modifications added.
	D	E	F			
	1-3 as 22-10-36	22-10-36	29-5-37			
Made L.L. Cond'r. Conns on Basebd No.27 amended and Title amended. Redrawn UA A was UA A79. L.L. No. was B1012 Strip Conn was Block Wrmly Signalling Earth was to Term-1, 7. Wire, E & F.P was E & C.C.						
Amendment						

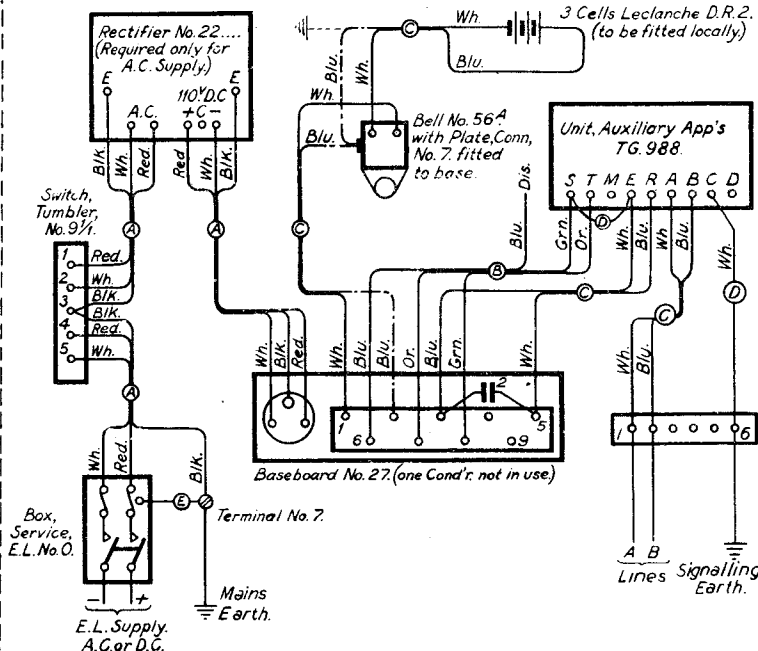

Notes:-

- For wiring see TG(L)800.
- The Power Cabling, which is continuous for D.C. supply, should be opened at the joint provided for the insertion of Rectifier No. 22... when supply is A.C.
- indicates original connexions replaced by - - - - - when modified for use with Teleprinter wired for S/R Switch working

Strip, Flex, Cord Conn, 6 Term.

- (A) Cable E.L. 250^v 3 core, 0-001 sq. ins.
- (B) " " " E & C core, 3 wire/10.
- (C) " " " " 1 pair/10.
- (D) Wire E & F.P. 1 wire/20.
- (E) Wire, Copper, soft stranded 3/20.

A B Signalling Lines Earth.